

8FT DECORATIVE FOAM PANEL FENCE ON STEEL POSTS


RATED FOR WIND SPEEDS UP TO **140 MPH**

NONSTRUCTURAL, DECORATIVE BARRIER, FOR INSTALLATION AT GRADE

THIS DRAWING IS A NON-SITE-SPECIFIC PERFORMANCE EVALUATION. A DESIGN PROFESSIONAL SHALL BE RESPONSIBLE FOR CERTIFYING THE APPLICATION OF THIS INFORMATION TO ANY SITE-SPECIFIC LOCATION.

COPIES WITHOUT
ORIGINAL PE SEAL NOT
VALID FOR PERMIT

SPACE RESERVED FOR
CERTIFYING ENGINEER'S
DIGITAL OR PHYSICAL SEAL
& DATE OF CERTIFICATION

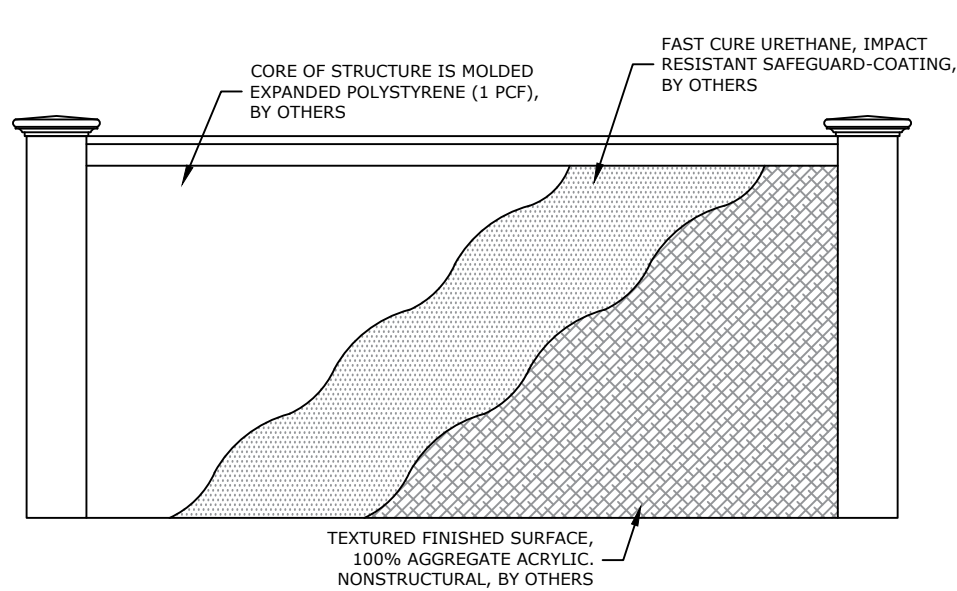


1
1
GENERAL FENCE LAYOUT
NOT TO SCALE
ELEVATION

THIS IS A NON-SITE-SPECIFIC PERFORMANCE EVALUATION. A DESIGN PROFESSIONAL SHALL BE RESPONSIBLE FOR CERTIFYING THE APPLICATION OF THIS INFORMATION TO ANY SITE-SPECIFIC LOCATION. NO CERTIFICATION IS OFFERED FOR USE WITHOUT A CORRESPONDING SITE SPECIFIC PLAN UNDER SEPARATE CERTIFICATION. VALID AS A GENERIC PERFORMANCE EVALUATION ONLY FOR UP TO **250FT OF COMMERCIAL OR RESIDENTIAL** FENCING AT (1) LOCATION.

THIS DOCUMENT IS NOT TO BE USED WITHOUT AN ORIGINAL PEN SIGNATURE & RAISED SEAL OR ELECTRONICALLY VERIFIABLE ELECTRONIC SIGNATURE MEETING ALL DISCLAIMERS SET FORTH HEREIN. RUBBED PENCIL COPIES ARE NOT PERMITTED FOR USE IN ANY WAY


FOOTING NOTES:

- VALID FOR USE IN EXPOSURES 'C' & 'D' INSIDE & OUTSIDE THE FLORIDA HIGH VELOCITY HURRICANE ZONE (HVHZ, DADE & BROWARD COUNTIES) UP TO 115MPH Vult
- FOOTING DIMENSION (DIAMETER) SHALL BE EITHER THE DIAMETER OF A ROUND OR DIMENSIONS OF A SQUARE FOOTING.
- FOOTERS DESIGNED USING LIMITING CRITERIA IN FBC / IBC CHAPTER 2328 INSIDE THE FL HVHZ AND CONSIDERED VALID FOR USE OUTSIDE HVHZ IN EXPOSURE 'C' AND 'D' CONDITIONS. THE PRODUCT MAY LIST BUT STAY IN TACT IN SATURATED SOIL AT PEAK WINDS AND IS STILL CONSIDERED PROPERLY DESIGNED.
- FOOTING SPECIFICATIONS ASSUME 5' MAX FENCE POST SPAN.
- FOR FENCES WITH CONCRETE FOOTINGS EMBEDDED INTO SOIL, DESIGN IS SUCH THAT FENCES MAY LIST DURING PERIODS OF HIGH WINDS AND SATURATED SOILS AND IS STILL CONSIDERED PROPERLY DESIGNED

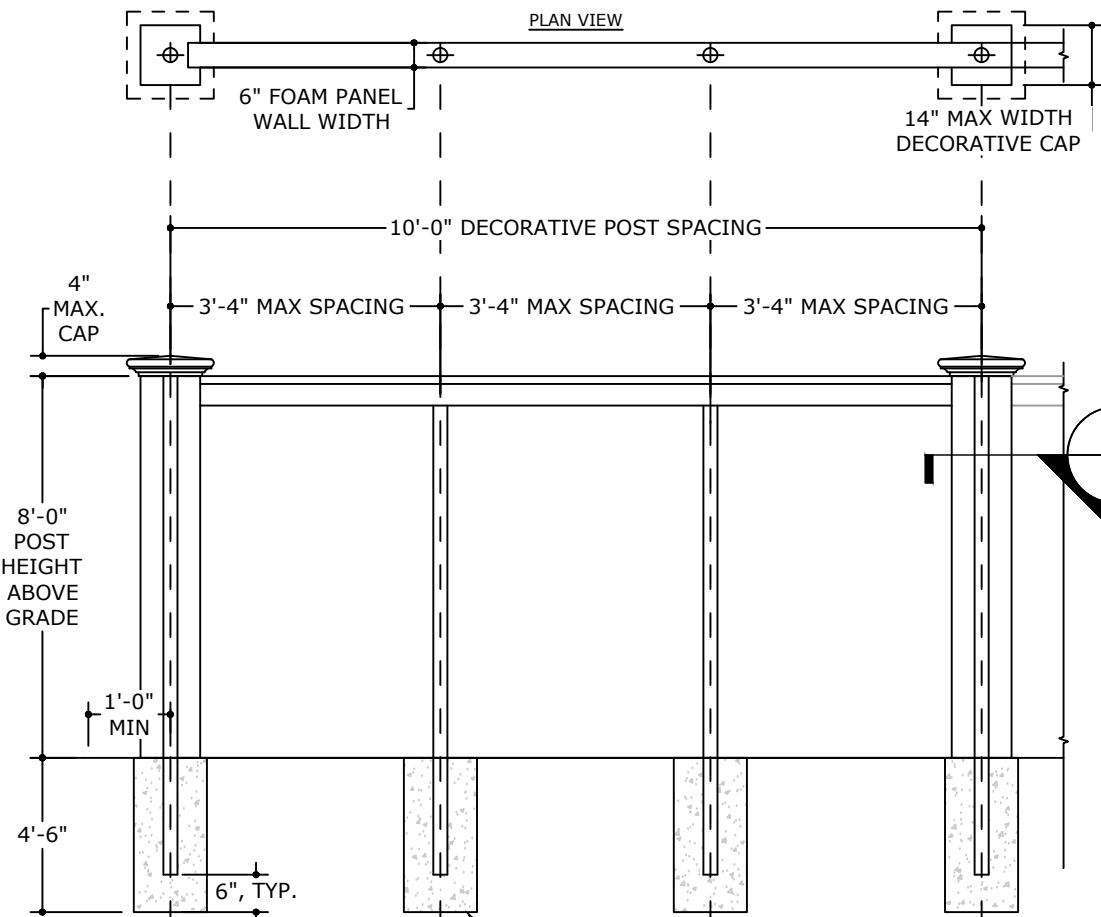

2
1
STRUCTURAL SECTION FOR FENCE
NOT TO SCALE
SECTION

FOR 8'-0" TALL FENCE:
PROVIDE 24" Ø OR SQUARE X 54" DEPTH CONCRETE FOOTING, 3KSI MIN.
CONCRETE MIX SHALL INCLUDE .1% FIBERMESH REINFORCEMENT ADMIXTURE PER CUBIC YARD

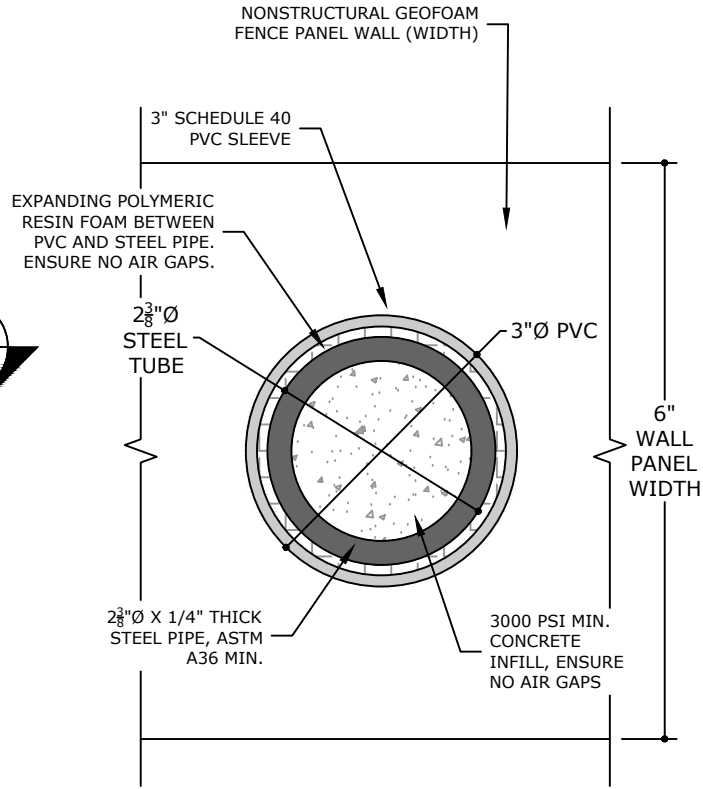

3
1
FENCE POST ASSEMBLY
NOT TO SCALE
SECTION

DESIGN CRITERIA:

CURRENT STATE BUILDING CODE
INTERNATIONAL BUILDING CODE & RESIDENTIAL CODE (2018 & 2021)
ASCE 7-22 LOAD COMBINATIONS

- WIND LOADING DESIGN CRITERIA
 - METHODOLOGY..... SOLID WALL & FENCE (PER ASCE 29.4) 140 MPH (ASD = $\sqrt{Q(0.6) \cdot V_{ult}}$)
 - ULTIMATE WIND SPEED.....
- RISK CATEGORY..... RISK II
- WIND EXPOSURE FACTOR..... D
- DIRECTIONALITY/OTHER FACTORS..... Kd=0.85, G=0.85, Kz=1.0
- SYSTEM MOUNTING HEIGHT..... 0 FEET (AT GRADE)
- RESULTANT DESIGN WIND LOADING: 36 PSF**

DESIGN, CODES, AND CALCULATIONS

DESIGN NOTES

- ALLOWABLE DESIGN PRESSURES UTILIZED IN THIS DOCUMENT HAVE BEEN CALCULATED PER THE REQUIREMENTS OF THE CODES AND STANDARDS STATED HEREIN USING ASCE 7-16 ALLOWABLE STRESS DESIGN METHODOLOGY WITH THE CRITERIA AS OUTLINED HEREIN. THE CONTRACTOR SHALL CONTACT THE AUTHORITY HAVING JURISDICTION TO ENSURE APPROPRIATE CRITERIA TO BE USED BEFORE CONSTRUCTION BEGINS.
- THIS DRAWING SET IS PREPARED AS A SITE SPECIFIC DESIGN. TYPICAL FIELD CONDITIONS HAVE BEEN ASSUMED.
- NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM.
- ANY EXISTING HOST STRUCTURE MUST BE CAPABLE OF SUPPORTING THE LOADED SYSTEM AS VERIFIED BY THE ENGINEER & OR ARCHITECT OF RECORD, et.al. THE HOST STRUCTURE WHICH IS DESIGNED, CERTIFIED, AND INSPECTED BY OTHERS MUST PROVIDE SUFFICIENT CAPACITY FOR THE SYSTEM & REACTIONS DETAILED HEREIN. NO

WARRANTY OR GUARANTEE TO THESE CONDITIONS, EITHER EXPRESSED OR IMPLIED, IS OFFERED WITH THIS CERTIFICATION. SHOP DRAWINGS SHALL BE SUBMITTED FOR E.O.R. REVIEW AND APPROVAL BEFORE INSTALLATION. FOR FENCES WITH CONCRETE FOOTINGS EMBEDDED INTO SOIL, DESIGN IS SUCH THAT FENCES MAY LIST DURING PERIODS OF HIGH WINDS AND SATURATED SOILS AND IS STILL CONSIDERED PROPERLY DESIGNED

STRUCTURAL MATERIALS & CONNECTIONS

STEEL

- STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED IN ACCORDANCE WITH THE LATEST A.I.S.C. STEEL CONSTRUCTION MANUAL AND SHALL CONFORM WITH THE LATEST A.S.T.M. SPECIFICATIONS
- STEEL MATERIALS SHALL CONFORM TO THE FOLLOWING MINIMUM REQUIREMENTS UNLESS OTHERWISE NOTED ON THE CONTRACT DOCUMENTS:

ROLLED SHAPES AND CHANNELS: ASTM A572 OR A992, MIN. YIELD STRENGTH 50 KSI

ANGLES FOR TRUSSES AND BRACES: ASTM A36 MIN YIELD STRENGTH 36 KSI
MISCELLANEOUS ANGLES: ASTM A36
HOLLOW STRUCTURAL SECTIONS: ASTM A500 GRADE B, MIN YIELD STRENGTH 42 KSI FOR ROUND AND 46 KSI FOR RECTANGULAR HSS
3. CONNECTION MATERIAL SHALL CONFORM TO THE FOLLOWING MINIMUM REQUIREMENTS OR AS NEEDED FOR CONNECTION DESIGN:
ANGLES: ASTM A36
WTS: ASTM A992
ASTM A572, MIN YIELD STRENGTH 50 KSI
ASTM A325
ASTM A563
WASHERS: ASTM F436
ANCHOR RODS: ASTM F1554 GRADE 55 WITH WELDABILITY

SUPPLEMENT S1
WELD ELECTRODES: E70XX

- ALL OTHER STEEL MEMBERS NOT SPECIFIED SHALL CONFORM TO ASTM A36 STAINLESS STEEL UNLESS OTHERWISE NOTED
- SHOW ALL COPES, HOLES, OPENINGS AND MODIFICATIONS REQUIRED IN STRUCTURAL STEEL MEMBERS FOR ERECTION OR THE WORK OF OTHER TRADES ON THE SHOP DRAWINGS FOR APPROVAL BY THE ARCHITECT AND STRUCTURAL ENGINEER.
- FIELD MODIFICATION OF STRUCTURAL STEEL IS PROHIBITED WITHOUT PRIOR APPROVAL OF THE ARCHITECT AND STRUCTURAL ENGINEER.
- STEEL MEMBERS IN CONTACT WITH CONCRETE AND WOOD SHALL BE PROTECTED BY "KOPPERS BITUMINOUS PAINT" OR STEEL PRIMER IN ACCORDANCE WITH CURRENT FLORIDA BUILDING CODE. ALL WELDS TO BE COVERED WITH NON-REACTIVE PAINT
- FOR STEEL MEMBERS AND EMBEDMENTS EXPOSED TO WEATHER, PROVIDE HOT-DIPPED GALVANIZED FINISH.
- THE CONTRACTOR IS RESPONSIBLE TO INSULATE ALL MEMBERS FROM DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS.

OTHER MATERIALS

- EPS CORE COMPOSITE PANELS SHALL BE CONSTRUCTED USING TYPE 3105-H154 ALUMINUM FACINGS, EXPANDED POLYSTYRENE FOAM SHALL HAVE TYPICAL DENSITY OF 1.0 PCF & 2.0 PCF AND SHALL BE MANUFACTURED BY DYPLAST PRODUCTS. THE EPS FOAM SHALL BE ADHERED TO THE ALUMINUM FACING WITH ISOGRIP SP 202 ADHESIVE (BY ASHLAND SPECIALTY). FABRICATION SHALL BE IN ACCORDANCE WITH APPROVED FABRICATION METHODS BY MANUFACTURER FOR ALL PANELS.
- IF APPLICABLE, COMPOSITE PANELS SHALL COMPLY WITH CHAPTER 7 SECTION 721, CHAPTER 8 SECTION 803, CLASS A INTERIOR FINISH, AND CHAPTER 26 SECTION 2603 OF THE FLORIDA/INTERNATIONAL CODE.
- EXPANDED POLYSTYRENE FOAM SHALL HAVE TYPICAL DENSITY OF 1.0 PCF.
- PVC INFORMATION: ALL PVC RESIN TO BE ASTM01784 EXTRUDED D638 FLEX STR. 9600PSI D790. ALL TO CONFORM TO ASTM F 964 FOR

RIGID POLYVINYL PROFILES.

NON-STRUCTURAL ELEMENTS:

- THE INSTALLATION OF ANY ACCESSORIES THAT DO NOT AFFECT THE STRUCTURAL INTEGRITY OF THE STRUCTURE ARE OUTSIDE THE SCOPE OF THIS CERTIFICATION AND NOT REQUIRED TO BE CERTIFIED WITHIN THIS STRUCTURAL DRAWING. THEY MAY BE INSTALLED WITHIN LIMITATIONS STATED HEREIN AND AS DESIRED PER MFR. SPECIFICATIONS. DETAILS PROVIDED HEREIN ARE FOR REFERENCE ONLY

FOUNDATIONS, CONCRETE, AND REINFORCEMENT

CONCRETE

- CONCRETE MIXTURES SHALL BE DESIGNED TO REACH A COMPRESSIVE STRENGTH OF 8,000 PSI IN 28 DAYS UNO.
- ALL MIXING, TRANSPORTING, PLACING, & CURING OF CONCRETE SHALL BE IN ACCORDANCE WITH ACI 318.
- NO ADMIXTURES ARE TO BE USED WITHOUT THE WRITTEN APPROVAL OF THE ABOVE-SIGNED ENGINEER.
- CONCRETE SHALL BE TYPE 1 PORTLAND CEMENT MEETING THE REQUIREMENTS OF ASTM C150, AGGREGATES TO MEET ASTM C33. POTABLE WATER SHALL BE USED.
- SLUMP SHALL BE A MINIMUM OF 3" AND MAXIMUM OF 5" CONCRETE DURING AND IMMEDIATELY AFTER DEPOSITING SHALL BE THOROUGHLY COMPACTED BY MEANS OF MECHANICAL VIBRATION.

REINFORCING STEEL

- WHEN REINFORCING STEEL IS NOTED AS CONTINUOUS REINFORCING IN SLABS, WALLS, AND/OR BEAMS, SPLICE CONTINUOUS REINFORCING STEEL ONLY WHEN UNAVOIDABLE DUE TO STOCK LENGTHS.
 - LAP CONTINUOUS REINFORCING A MINIMUM OF 48 BAR DIAMETERS IN BEAMS & COLUMNS, 36 BAR DIAMETERS IN SLABS. STAGGER ALL SPLICES A MINIMUM OF FOUR FEET. ADJACENT BAR WITH SPLICES ARE NOT ACCEPTABLE.
 - LOCATE TOP BAR FOR SPLICES WITHIN MIDDLE HALF GO THE SPAN AND LOCATE BOTTOM BAR SPLICES AT SUPPORTS, OR

- ALL REINFORCEMENT SHALL BE DEFORMED BARS OF INTERMEDIATE GRADE NEW BILLET STEEL CONFORMING TO CURRENT REQUIREMENTS OF ASTM A615, GRADE 60 (U.O.N.), FREE FROM OIL, LOOSE SCALE AND LOOSE RUST AND BENT, LAPPED, PLACED, SUPPORTED AND FASTENED ACCORDING TO THE "ACI DETAILING MANUAL" (SP-66) AND THE ACI 318.
- CLEAR COVER FOR REINFORCEMENT SHALL BE AS FOLLOWS UNLESS OTHERWISE NOTED:
 - FOOTINGS PERMANENTLY EXPOSED TO EARTH: 3"
- ALL STEEL SHALL BE SECURELY HELD IN PLACE DURING POURING OF CONCRETE. IF REQUIRED, ADDITIONAL BARS SHALL BE PROVIDED BY THE GENERAL CONTRACTOR TO FURNISH SUPPORT FOR ALL BARS.

GENERAL NOTES & DISCLAIMERS

- DIMENSIONS ARE SHOWN TO ILLUSTRATE DESIGN FORCES AND OTHER DESIGN CRITERIA. THEY MAY VARY SLIGHTLY, BUT SHALL REMAIN IN CONFORMANCE WITH THE LIMITATIONS OF THIS PLAN. THE CONTRACTOR IS TO VERIFY ALL FIELD DIMENSIONS PRIOR TO INSTALLATION, AND VERIFY THAT PROPOSED DIMENSIONS AND FIELD CONDITIONS AGREE WITH THIS PROPOSED PLAN. USE OF THIS DOCUMENT CONSTITUTES ACCEPTANCE OF THE PROPOSED SYSTEM LAYOUT, COMPONENTS SELECTED, AND INSTALLATION. THESE DRAWINGS ARE NOT INTENDED TO BE USED AS FABRICATION OR SHOP DRAWINGS.
- ENGINEERING EXPRESS HAS NOT VISITED THIS JOBSITE. INFORMATION CONTAINED HEREIN IS BASED ON CONTRACTOR SUPPLIED DATA AND MEASUREMENTS. ENGINEERING EXPRESS SHALL NOT BE HELD RESPONSIBLE OR LIABLE IN ANY WAY FOR ERRONEOUS OR INACCURATE DATA OR MEASUREMENTS. WORK SHALL BE FIELD VERIFIED PRIOR TO CONSTRUCTION. THIS ENGINEERING SHALL BE NOTIFIED AND GIVEN AN OPPORTUNITY TO REEVALUATE OUR WORK UPON DISCOVERY OF ANY INACCURATE INFORMATION PRIOR TO MODIFICATION OF EXISTING FIELD CONDITIONS AND FABRICATION AND INSTALLATION OF MATERIALS.

- USE OF THIS SIGNED & SEALED DOCUMENT CONSTITUTES ACCEPTANCE OF THE PROPOSED SYSTEM LAYOUT, COMPONENTS SELECTED, AND INSTALLATION REQUIREMENTS.
- THIS DOCUMENT SHALL NOT BE USED OR REPRODUCED WITHOUT THE ORIGINAL SIGNATURE & RAISED SEAL OF THE CERTIFYING P.E. ALTERATIONS, ADDITIONS OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION. PHOTOCOPIES AND UNSEALED DOCUMENTS ARE NOT TO BE ACCEPTED.
- ENGINEER SEAL AFFIXED HERETO VALIDATES STRUCTURAL DESIGN AS SHOWN ONLY. USE OF THIS SPECIFICATION BY CONTRACTOR, et. al. INDEMNIFIES & SAVES HARMLESS THIS ENGINEER FOR ALL COST & DAMAGES INCLUDING LEGAL FEES & APPELLATE FEES RESULTING FROM MATERIAL FABRICATION, SYSTEM ERECTION, & CONSTRUCTION PRACTICES BEYOND THAT WHICH IS CALLED FOR BY LOCAL, STATE, & FEDERAL CODES & FROM DEVIATIONS OF THIS PLAN.
- THIS DOCUMENT IS GENERIC AND DOES NOT PERTAIN TO ANY SPECIFIC PROJECT SITE. INFORMATION CONTAINED HEREIN IS BASED ON CONTRACTOR-SUPPLIED DATA AND MEASUREMENTS. ENGINEERING EXPRESS SHALL NOT BE HELD RESPONSIBLE OR LIABLE IN ANY WAY FOR ERRONEOUS OR INACCURATE DATA OR MEASUREMENTS. DIMENSIONS ARE SHOWN TO ILLUSTRATE DESIGN FORCES AND OTHER DESIGN CRITERIA. THEY MAY VARY SLIGHTLY, BUT MUST REMAIN WITHIN THE LIMITATIONS SPECIFIED HEREIN. WORK SHALL BE FIELD VERIFIED BY OTHERS PRIOR TO CONSTRUCTION. ENGINEERING EXPRESS SHALL BE NOTIFIED AND GIVEN AN OPPORTUNITY TO REEVALUATE OUR WORK UPON DISCOVERY OF ANY INACCURATE INFORMATION PRIOR TO MODIFICATION OF EXISTING FIELD CONDITIONS AND FABRICATION AND INSTALLATION OF MATERIALS.
- ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE ONLY PERMITTED TO SHOW SITE-SPECIFIC CONDITIONS, HOWEVER ANY CHANGES, ALTERATIONS OR ADDITIONS MADE TO THE CONTENT OF THIS DOCUMENT WILL INVALIDATE THIS CERTIFICATION.
- EXCEPT AS EXPRESSLY PROVIDED HEREIN, NO ADDITIONAL CERTIFICATIONS OR AFFIRMATIONS ARE INTENDED

DIGITAL SEAL NOTICE:
IF THIS DOCUMENT IS DIGITALLY SIGNED, THIS ITEM HAS BEEN DIGITALLY SIGNED BY THE ABOVE-SIGNING ENGINEER ON THE DATE ADJACENT TO THE SEAL. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.
VISIT EALC.IO/DS FOR MORE INFORMATION.
PRINTED DOCUMENT NOTICE:
IF THIS DOCUMENT IS PRINTED & DOES NOT CONTAIN AN ENGINEER'S ORIGINAL SIGNATURE & SEAL, THIS DOCUMENT IS VOID & NOT VALID FOR USE. PHOTOCOPIES ARE NOT PERMITTED FOR USE. **VALID FOR 1 PERMIT ONLY U.N.O.**

ENGINEERING EXPRESS
POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

ROYAL FOAM US, LLC DBA
"GREEN WALL CONSTRUCTION"
4225 JAMES E CASEY DRIVE, UNIT 5
JACKSONVILLE, FL 32219
DECORATIVE FOAM PANEL FENCE ON STEEL POSTS
PERFORMANCE EVALUATION
ASCE 7-22 / IBC 2021

DATE	DRWN	CHKD	DATE	INIT	ISSUE	REMARKS
5/9/25	ANC	CCB	-	-	-	THIS DOCUMENT IS THE PROPERTY OF ENGINEERING EXPRESS, AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF ENGINEERING EXPRESS. ALTERATIONS, ADDITIONS OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT ENGINEERING EXPRESS®
25-85090
SCALE: NTS UNLESS NOTED
1 OF 1